

FIRE ALARM SYSTEM  
 Test & Inspection Report  
 VERMONT PROOF OF INSPECTION STICKER #13-01958  
 SYSTEM IDENTIFICATION # F-27728  
 Amended 7-3-13

**Customer:** Champlain Apartments – 323-325 College St.

**Date:** April 11, 2013

**Contact:** Gene Richards

**Location:** 323-325 College St.,  
Burlington

**Time:** Start: 11:00 End: 1:00 Total: 2:00

**Techs Sent:** MF, MC

**Panel Make & Model:** Silent Knight 5208

**Date Installed:** August 2011

	(Ah)	<u>AC Line</u>	<u>DC Charge Rate</u>	<u>Battery Voltage Under Load</u>	
				<u>DC Starting</u>	<u>DC Ending</u>
Power Supply	( 7 )	121.9	27.5	26.1	25.5
Booster	( 7 )	121.9	27.3	26.6	25.2
<u>Manual Pull Stations</u>		Qty: 7	# Zones: 3	Tested: 7	
<u>Signal Horn/Strobes</u>		Qty: 9	# Zones: 5	Tested: 9	
Apartment Horns		Qty: 15	# Zones: 5	Tested: 15	
AC Strobes		Qty: 9	# Zones: 5	Tested: 9	
Outside Horn/Strobe		Qty: 6	# Zones: 1	Tested: 6	
Horn		Qty: 22	# Zones: 1	Tested: 22	
<u>Automatic Detection</u>					
Photoelectric Smokes		Qty: 8	# Zones: 4	Tested: 8	
AC Smokes		Qty: 2	# Zones: N/A	Tested: 2	
AC Smoke/CO Combo Units		Qty: 50	# Zones: N/A	Tested: 50	
Sprinkler Water Flow		Qty: 2	# Zones: 2	Tested: 2	
Sprinkler Tampers		Qty: 4	# Zones: 4	Tested: 4	

Notes: All smoke detectors tested are cleaned.

Auxiliary Features

Annunciator	Qty: 1	Tested: Yes
Door Holders	Qty: 2	Tested: 2
Digital Communicator to Home Security Acct. # 207-2851		Tested: Yes

Current Deficiencies

None

Deficiencies Corrected

N/A

**Comments:** 1) 1<sup>st</sup> floor center Fire door does not close properly. 2) Batteries dated August 2011. 3) Designed approved by fire marshal when installed. 4) Do not use artificial smoke when testing combo units. 5) CO detectors not required to be tied into the fire alarm system, and no pull station required outside door of apartment 1 per Barry Simays, as stated in 7/3/2013 email.

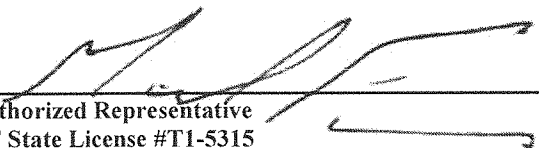
FIRE ALARM SYSTEM  
Test & Inspection Report  
VERMONT PROOF OF INSPECTION STICKER #13-01958  
SYSTEM IDENTIFICATION # F-27728  
**Amended 7-3-13**

**Customer:** Champlain Apartments – 323-325 College St.

**Date:** April 11, 2013

**Contact:** Gene Richards

**Location:** 323-325 College St.,  
Burlington

  
\_\_\_\_\_  
Authorized Representative  
VT State License #T1-5315  
cc: VT Department of Public Safety - Williston  
Burlington Fire Department

\_\_\_\_\_  
Reviewed by #T1-5334